



90mm MDPE Pipe connected to 2 x 30K Litre tanks at the top of the hill.


ARANGA COAST ROAD

Fence Line

Site 20ft Container

Headworks

50mm Type B Camlock

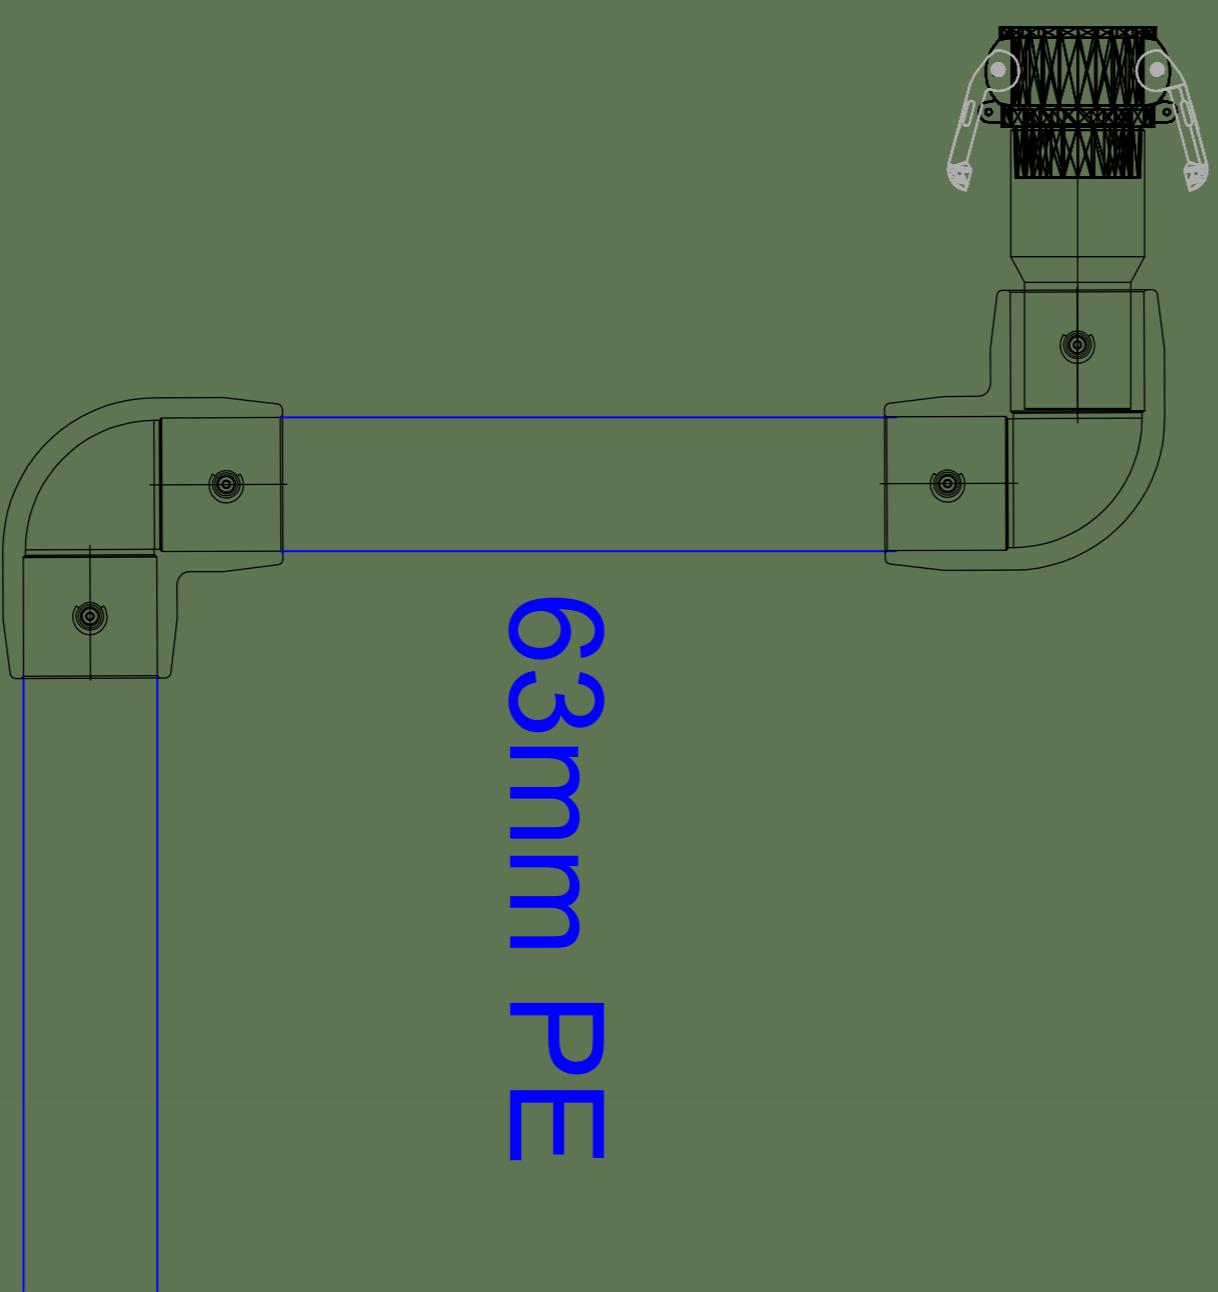


63mm PE

- MDPE Pipe 63mm
- MDPE Pipe 90mm
- - - Multi Core Control Wire to each Solenoid

- + Hunter Solenoid Valve 50mm
- + Hydrant Connection 50mm
- + 50mm Isolation Valve
- + GSI Control System
- + Water Supply via Tanks at the top of the Hill (due North)

Mainline

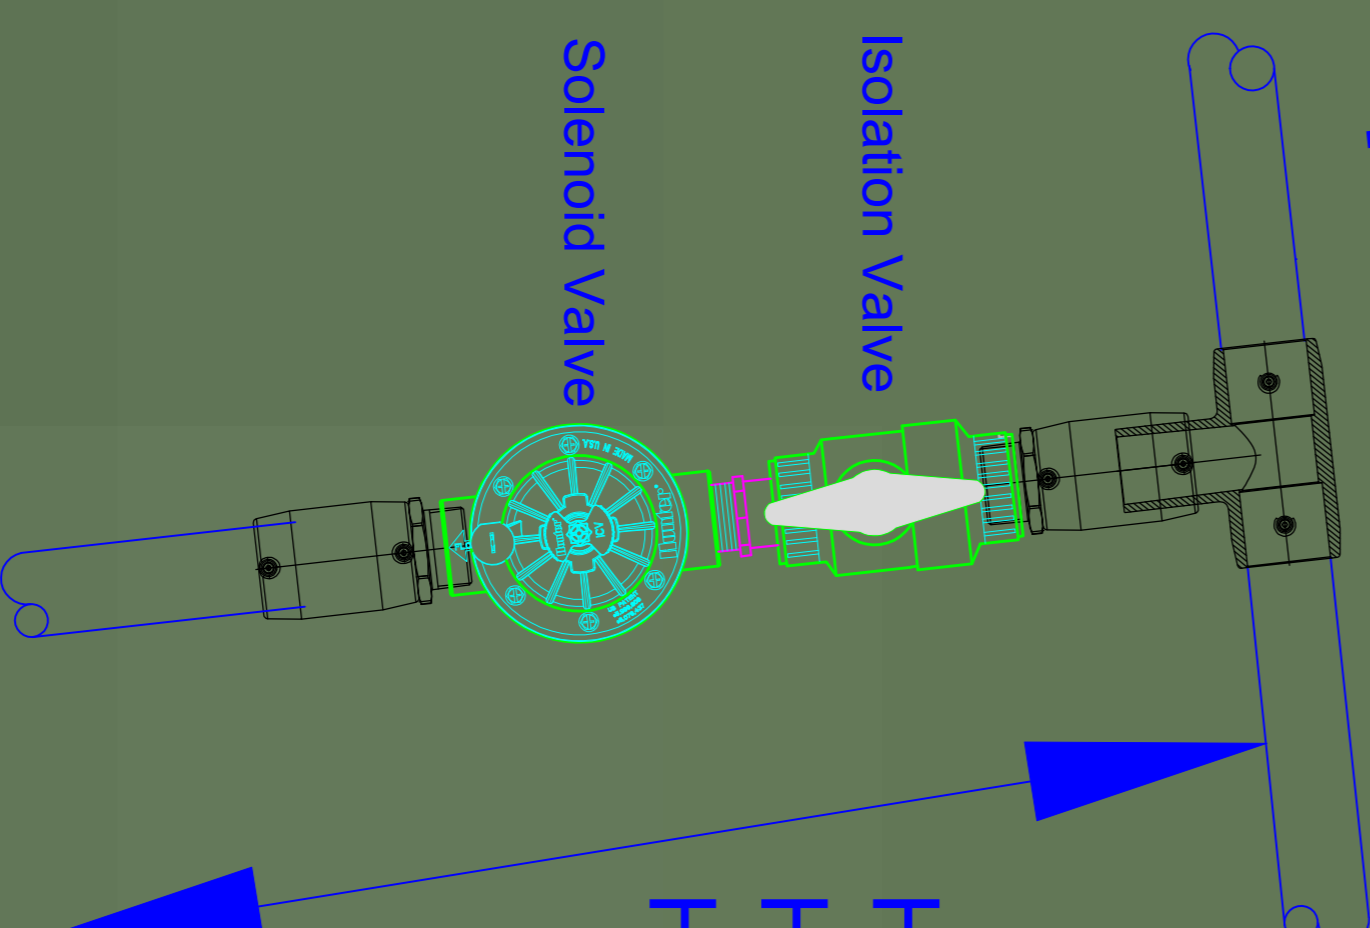

Hydrants 14.5m apart
 Hydrants 1-8 = 3m from Mainline to Camlock
 Hydrants 9-12 = 1.5m from Mainline to Camlock

Thinkwater Northland

Maunganuī Bluff Irrigation Site
 Kaipara District Council

Designer: Cam Walker

Date: 20.02.21 Scale: NTS

